

City of Hartsville Fire Department


Hartsville, SC

This report was generated on 11/2/2022 9:03:50 AM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 10/01/2022 | End Date: 10/31/2022

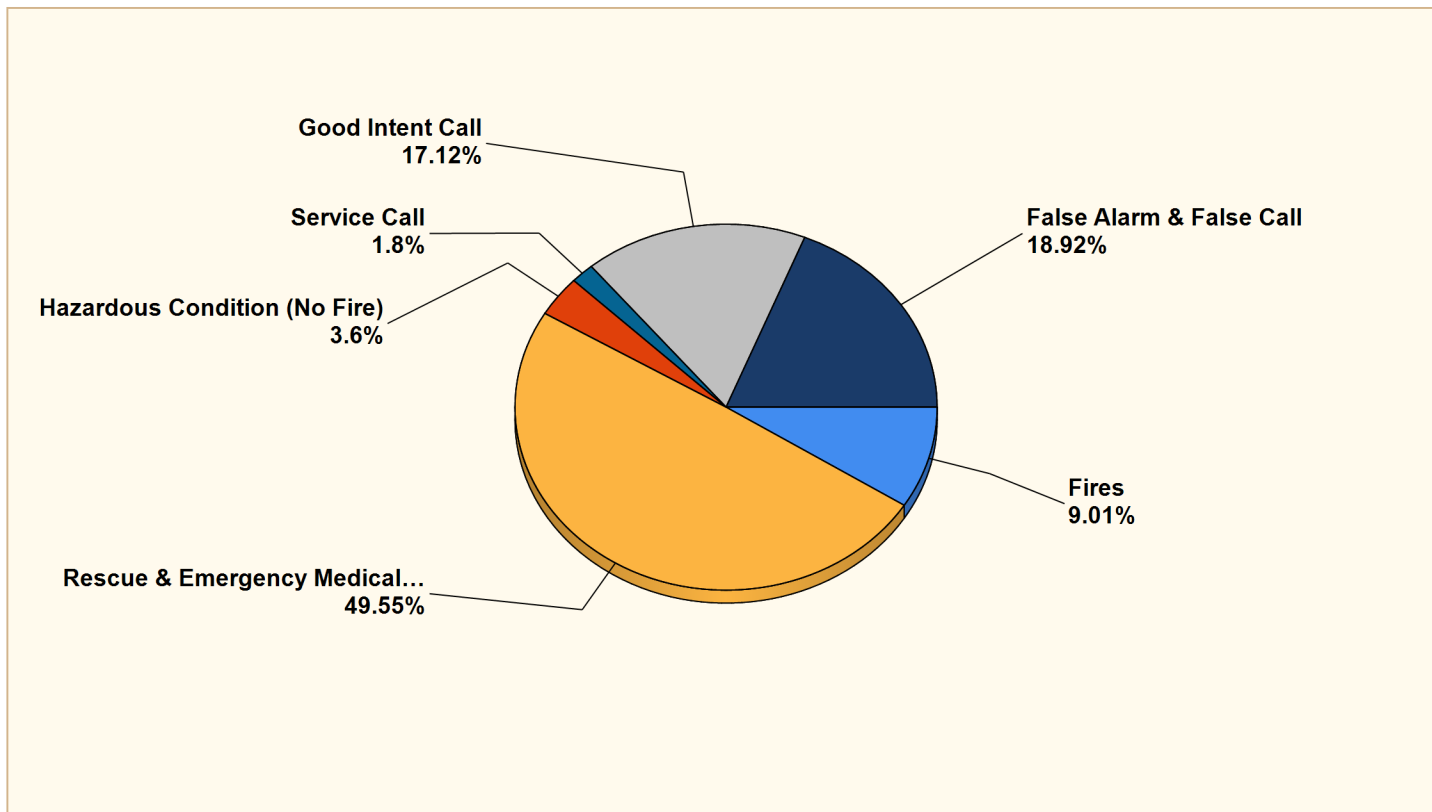

| MAJOR INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|------------------------------------|-------------|-------------|
| Fires | 10 | 9.01% |
| Rescue & Emergency Medical Service | 55 | 49.55% |
| Hazardous Condition (No Fire) | 4 | 3.6% |
| Service Call | 2 | 1.8% |
| Good Intent Call | 19 | 17.12% |
| False Alarm & False Call | 21 | 18.92% |
| TOTAL | 111 | 100% |

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



Detailed Breakdown by Incident Type

| INCIDENT TYPE | # INCIDENTS | % of TOTAL |
|--|-------------|-------------|
| 111 - Building fire | 2 | 1.8% |
| 140 - Natural vegetation fire, other | 2 | 1.8% |
| 142 - Brush or brush-and-grass mixture fire | 1 | 0.9% |
| 143 - Grass fire | 1 | 0.9% |
| 151 - Outside rubbish, trash or waste fire | 4 | 3.6% |
| 311 - Medical assist, assist EMS crew | 18 | 16.22% |
| 321 - EMS call, excluding vehicle accident with injury | 10 | 9.01% |
| 322 - Motor vehicle accident with injuries | 9 | 8.11% |
| 323 - Motor vehicle/pedestrian accident (MV Ped) | 2 | 1.8% |
| 324 - Motor vehicle accident with no injuries. | 13 | 11.71% |
| 352 - Extrication of victim(s) from vehicle | 2 | 1.8% |
| 353 - Removal of victim(s) from stalled elevator | 1 | 0.9% |
| 412 - Gas leak (natural gas or LPG) | 1 | 0.9% |
| 424 - Carbon monoxide incident | 1 | 0.9% |
| 444 - Power line down | 1 | 0.9% |
| 463 - Vehicle accident, general cleanup | 1 | 0.9% |
| 551 - Assist police or other governmental agency | 1 | 0.9% |
| 552 - Police matter | 1 | 0.9% |
| 611 - Dispatched & cancelled en route | 18 | 16.22% |
| 622 - No incident found on arrival at dispatch address | 1 | 0.9% |
| 710 - Malicious, mischievous false call, other | 1 | 0.9% |
| 711 - Municipal alarm system, malicious false alarm | 3 | 2.7% |
| 721 - Bomb scare - no bomb | 1 | 0.9% |
| 733 - Smoke detector activation due to malfunction | 2 | 1.8% |
| 735 - Alarm system sounded due to malfunction | 7 | 6.31% |
| 740 - Unintentional transmission of alarm, other | 1 | 0.9% |
| 743 - Smoke detector activation, no fire - unintentional | 5 | 4.5% |
| 745 - Alarm system activation, no fire - unintentional | 1 | 0.9% |
| TOTAL INCIDENTS: | 111 | 100% |

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.

