

# City of Hartsville Fire Department


Hartsville, SC

This report was generated on 1/3/2023 8:11:41 AM



## Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 12/01/2022 | End Date: 12/31/2022

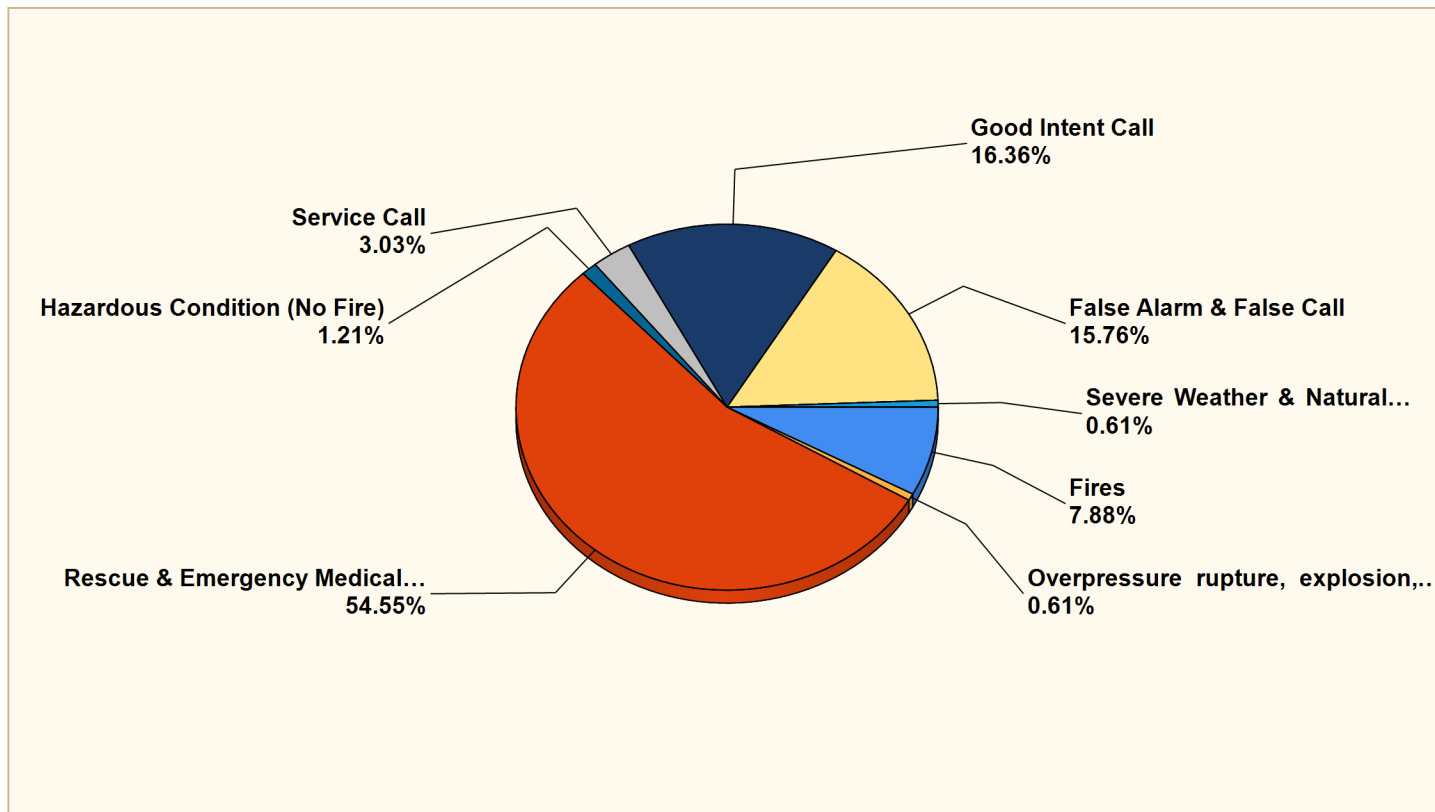

MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	13	7.88%
Overpressure rupture, explosion, overheating - no fire	1	0.61%
Rescue & Emergency Medical Service	90	54.55%
Hazardous Condition (No Fire)	2	1.21%
Service Call	5	3.03%
Good Intent Call	27	16.36%
False Alarm & False Call	26	15.76%
Severe Weather & Natural Disaster	1	0.61%
<b>TOTAL</b>	<b>165</b>	<b>100%</b>

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



### Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
111 - Building fire	7	4.24%
113 - Cooking fire, confined to container	1	0.61%
131 - Passenger vehicle fire	2	1.21%
140 - Natural vegetation fire, other	1	0.61%
142 - Brush or brush-and-grass mixture fire	1	0.61%
143 - Grass fire	1	0.61%
251 - Excessive heat, scorch burns with no ignition	1	0.61%
311 - Medical assist, assist EMS crew	62	37.58%
321 - EMS call, excluding vehicle accident with injury	13	7.88%
322 - Motor vehicle accident with injuries	5	3.03%
323 - Motor vehicle/pedestrian accident (MV Ped)	2	1.21%
324 - Motor vehicle accident with no injuries.	8	4.85%
444 - Power line down	1	0.61%
460 - Accident, potential accident, other	1	0.61%
522 - Water or steam leak	1	0.61%
542 - Animal rescue	1	0.61%
551 - Assist police or other governmental agency	1	0.61%
553 - Public service	2	1.21%
600 - Good intent call, other	2	1.21%
611 - Dispatched & cancelled en route	23	13.94%
621 - Wrong location	1	0.61%
651 - Smoke scare, odor of smoke	1	0.61%
711 - Municipal alarm system, malicious false alarm	1	0.61%
731 - Sprinkler activation due to malfunction	1	0.61%
732 - Extinguishing system activation due to malfunction	1	0.61%
735 - Alarm system sounded due to malfunction	4	2.42%
740 - Unintentional transmission of alarm, other	1	0.61%
741 - Sprinkler activation, no fire - unintentional	2	1.21%
743 - Smoke detector activation, no fire - unintentional	13	7.88%
744 - Detector activation, no fire - unintentional	1	0.61%
745 - Alarm system activation, no fire - unintentional	2	1.21%
800 - Severe weather or natural disaster, other	1	0.61%
<b>TOTAL INCIDENTS:</b>	<b>165</b>	<b>100%</b>

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.

